




Basement



Second Floor

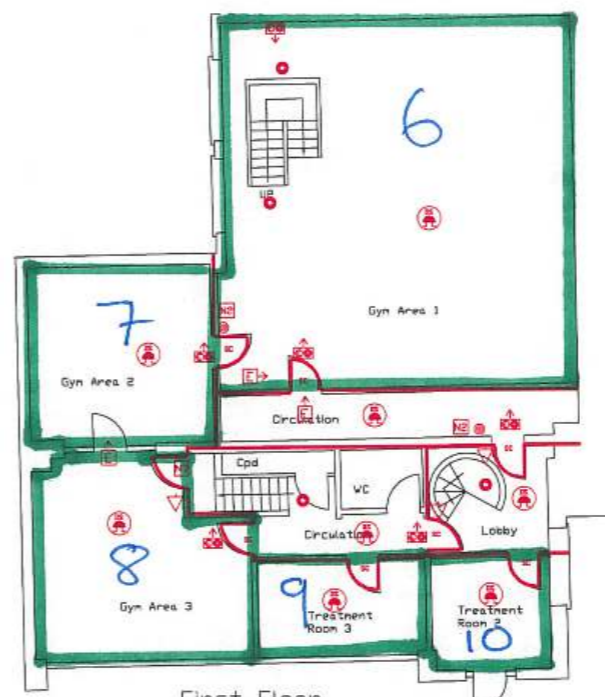

First Floor

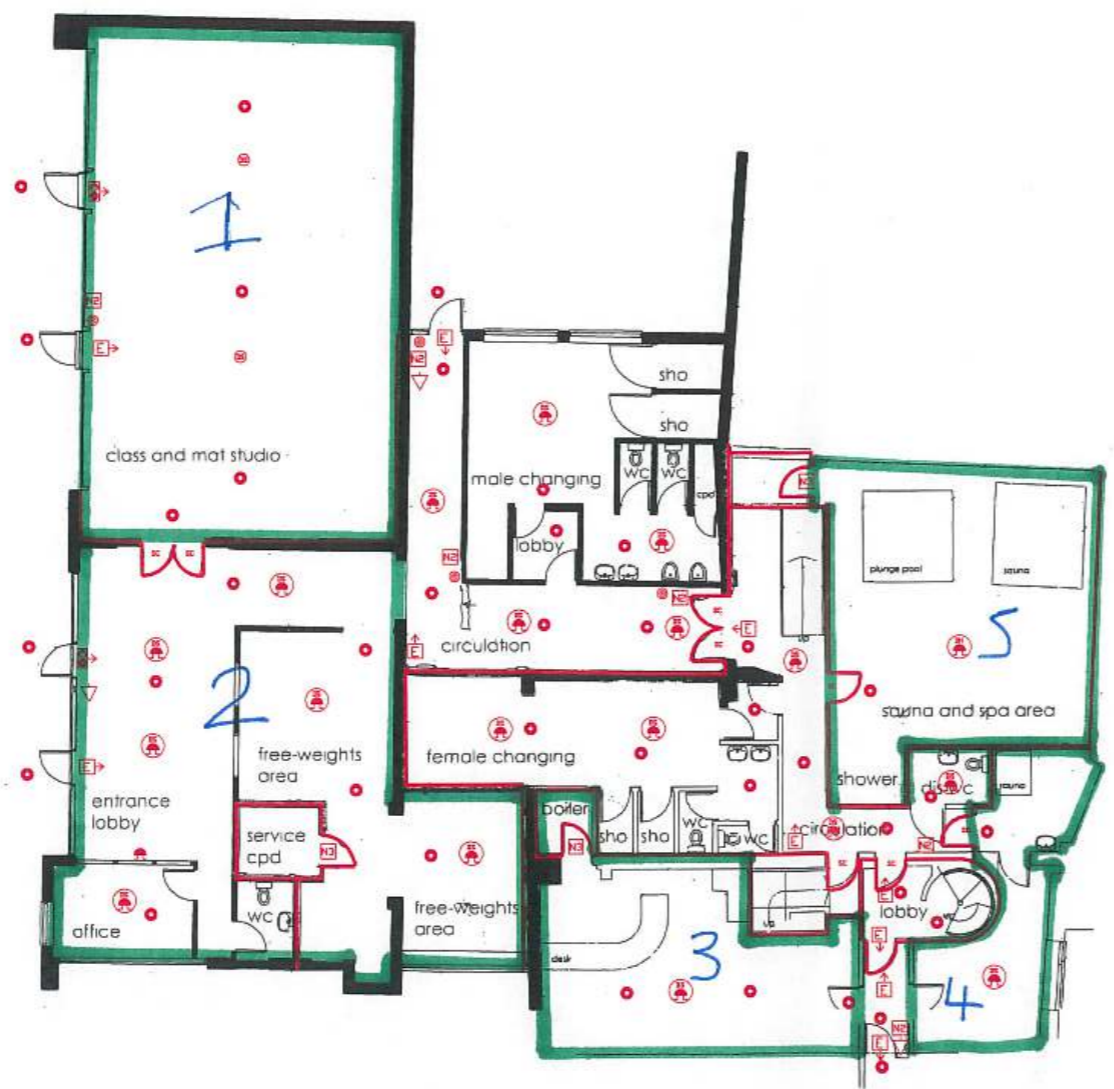

- LEGEND**
- EMERGENCY LIGHTING SYSTEM LIGHTING POINT CONNECTED TO AN EMERGENCY SYSTEM
 - ⊙ FIXED FIRE DETECTION EQUIPMENT SMOKE DETECTOR
 - ⊕ FIXED FIRE DETECTION EQUIPMENT SMOKE DETECTOR WITH VISUAL WARNING DEVICE
 - ⊗ FIXED FIRE DETECTION EQUIPMENT SMOKE DETECTOR COMBINED WITH AUDIBLE WARNING DEVICE
 - ⊘ FIXED FIRE DETECTION EQUIPMENT HEAT DETECTOR COMBINED WITH AUDIBLE WARNING DEVICE
 - ⊚ FIXED FIRE DETECTION EQUIPMENT SMOKE DETECTOR - IN CEILING VOID
 - ⊛ FIXED FIRE DETECTION EQUIPMENT HEAT DETECTOR
 - ⊜ REMOTE INDICATOR
 - ⊝ FIRE SAFETY SIGN FIRE EXIT SIGN
 - ⊞ FIRE SAFETY SIGN FIRE EXIT SIGN DIRECTIONAL
 - ⊟ FIRE SAFETY SIGN STAFF FIRE NOTICE
 - ⊠ FIRE SAFETY SIGN FIRE DOOR KEEP LOCKED
 - ⊡ FIRE SAFETY SIGN FIRE ESCAPE KEEP CLEAR
 - ⊢ FIRE WARNING SYSTEM ELECTRICAL INDICATOR PANEL
 - ⊣ GREEN BOX BREAK GLASS FOR SECURE DOOR
 - ⊤ EMERGENCY LIGHTING SYSTEM EXIT BOX WITH WIRING FOR NORMAL AND EMERGENCY SYSTEMS
 - ⊥ EMERGENCY LIGHTING SYSTEM EXIT BOX WITH WIRING FOR NORMAL AND EMERGENCY SYSTEMS - DIRECTIONAL
 - ⊦ FIRE WARNING SYSTEM ELECTRICAL FIRE ALARM CALL POINT
 - ⊧ FIRE WARNING SYSTEM ELECTRICAL AUDIBLE WARNING DEVICE
 - ⊨ FIRE WARNING SYSTEM ELECTRICAL VISUAL WARNING DEVICE
 - ⊩ PORTABLE FIRE EXTINGUISHER GENERAL EXTINGUISHER SYMBOL
 - ⊪ SELF CLOSING DOOR WITH SIGN 'FIRE DOOR KEEP SHUT'
 - ⊫ AUTOMATIC RELEASE SELF CLOSING WITH SIGN 'KEEP CLOSED AT NIGHT'
 - ⊬ ABBREVIATION PANIC BOLT
 - ⊭ PORTABLE FIRE EXTINGUISHER FIRE BLANKET
 - ⊮ GLAZED VISION PANEL
 - ⊯ FIRE RESISTANT GLASS
 - ⊰ FIRE RESISTANT WALL
 - ⊱ 30 MINS FIRE RESISTANCE
 - ⊲ SMOKE VENT CONTROL

A.F.S.
FIRE SAFETY CONSULTANTS
'Safer Working Environment'

Andrew Forth
(Crad I Fire E) (Nobash)
& Turner Close
Wymondham
Norfolk
NR18 0NP

Tel: (01953) 798084
Fax: (01953) 798084
Mobile: 07818 448906
Email: office@afsfire.co.uk

CLIENT
106 BER STREET
NORWICH

TITLE
BASEMENT, GROUND, 1st & 2nd FLOORS
FIRE SAFETY LAYOUT

SCALE 1:100	DRAWN BY K.R.F.
DRAWING No AFS/119/01	DATE 23/07/13